



CITY OF TAMPA

Pam Iorio, Mayor

CONTRACT ADMINISTRATION DEPARTMENT

David L. Vaughn, AIA, Director

ADDENDUM NO. 3
DATE: August 24, 2009

Project: 09-C-00036; TMOB HVAC Systems Upgrade


Bidders on the above referenced project are hereby notified that the following addendum is made to the Contract Documents. BIDS TO BE SUBMITTED SHALL CONFORM TO THIS NOTICE.

Item 1: Insert the attached Sheet Number E-2.2 into the plans set.

This addendum shall be included in and attached to the inside cover of the Contract Documents by and upon which bids are submitted. All other provisions of the Contract Documents and Specifications not in conflict with this Addendum shall remain in full force and effect. For questions concerning the above referenced project, please fax to 813/274-8080.

Jim Greiner, P.E., Contract Manager
Contract Administration Department

KEY NOTES

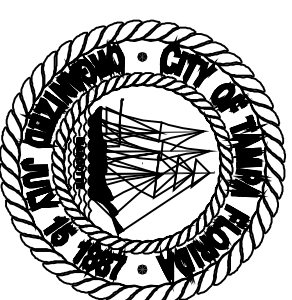

CITY OF TAMPA
 CONTRACT ADMINISTRATION
 DEPARTMENT AND DESIGN DIVISION
 500 N. GORRISON STREET 4 NORTH
 TAMPA, FL 33624
 P. 813.274.6656 - F. 813.274.4000
 or www.tampagov.net

James E. Johnson, P. Eng, NEMA
 Chief Architect
 Edward D. Rizzo, AIA
 Project Architect, AIA
 Thomas A. Heister, Sr., AIA, NEMA
 Project Architect
 Project Architect
 Supervisor, Architectural Drafting
 Kelsey C. Tillman
 Drafting Technician
 Henry P. Sweeney
 Byron K. Thomas, LEED AP
 Drafting Technician

MEP CONSULTANT

PARKER STEPHENS INCORPORATED
 4917 BRIDLECROFT BLVD, SUITE 204
 TAMPA, FL 33624
 P. 813.989-9194
 FAX. 813.989-9199

ELECTRICAL CONSULTANT

ORLANDO BENTON & BOWEN INC.
 8840 NORTH FLORIDA AVE
 TAMPA, FL 33624
 P. 813.989-9194
 FAX. 813.989-9199

STRUCTURAL CONSULTANT

CIVIL CONSULTANT

TMOB
 HVAC RENOVATION
 306 E JACKSON
 TAMPA, FLORIDA

DPW FILE NUMBER

DPW NUMBER


0119

ISSUE DATE

JULY 29, 2008

DRAWN BY

REVISIONS

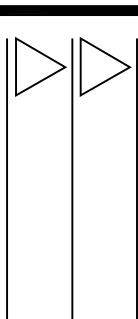

SEAL

ROBERTO DE LA GUERRA, P.E. No.61656

SCALE: AS NOTED

SHEET NUMBER

E-2.2

6 OF 9

NEW PANELBOARD "H5" SCHEDULE

| WIRE & CONDUIT | BUS AMPS | | | LOAD | BUS AMPS | WIRE & CONDUIT |
|----------------------|----------|---|---|----------|----------|---------------------|
| | A | B | C | | | |
| 3#1/2 & 1#1/2, 1/2"C | 6 | | | WAY-3-1 | 7 | 2#1/2 & 1#1/2 1/2"C |
| | 6 | | | | 11 | 2#1/2 & 1#1/2 1/2"C |
| | 6 | | | | 14 | 2#1/2 & 1#1/2 1/2"C |
| 3#1/2 & 1#1/2, 1/2"C | 10 | | | WAY-3-3 | 7 | 2#1/2 & 1#1/2 1/2"C |
| | 10 | | | | 11 | 2#1/2 & 1#1/2 1/2"C |
| 2#1/2 & 1#1/2, 1/2"C | 11 | | | WAY-3-5 | 10 | |
| | 11 | | | | 10 | |
| 2#1/2 & 1#1/2, 1/2"C | 11 | | | WAY-3-1 | 10 | |
| | 11 | | | | 10 | |
| 2#1/2 & 1#1/2, 1/2"C | 14 | | | WAY-3-13 | 10 | |
| | 14 | | | | 10 | |
| 3#1/2 & 1#1/2, 1/2"C | 6 | | | WAY-3-7 | 6 | |
| | 6 | | | | 6 | |
| 3#1/2 & 1#1/2, 1/2"C | 12 | | | WAY-3-9 | 12 | |
| | 12 | | | | 12 | |
| 3#1/2 & 1#1/2, 1/2"C | 14 | | | AHU-3 | 14 | |
| | 14 | | | | 14 | |
| 3#1/2 & 1#1/2, 1/2"C | 14 | | | SPACE | 14 | |
| | 14 | | | | 14 | |

TOTAL CONNECTED AMPS: 75
 RATE VOLTAGE: 277/480 3 PHASE, 4 WIRE
 RATED AMPS OF: 225 BUSING 225 MLO
 FULLY RATED BREAKER ISC 42 K AIG SWML
 LOCATION: 5TH FL. MECH. ROOM
 CONNECTED AMPS PER PHASE = 90

EXISTING PANELBOARD "H6" SCHEDULE

| WIRE & CONDUIT | BUS AMPS | | | LOAD | BUS AMPS | WIRE & CONDUIT |
|----------------------|----------|---|---|--------------------|----------|----------------|
| | A | B | C | | | |
| 3#1/0 & 1#6, 2"C | 93 | | | PANEL H6 | 150 | 1" A 1/2" |
| | 93 | | | | 150 | 1" B 1/2" |
| | 93 | | | | 150 | 1" C 1/2" |
| 3#1/0 & 1#1/0, 3/4"C | 18 | | | EDH-3 | 30 | 1" A 1/4" |
| | 18 | | | | 30 | 1" B 1/8" |
| | 18 | | | | 30 | 1" C 1/2" |
| | | | | SPARE | | |
| | | | | | 20 | 1" A 1/8" |
| | | | | | 20 | 1" B 1/8" |
| | | | | | 20 | 1" C 1/2" |
| | | | | 6TH FLOOR AHU | 30 | 2" A 26/30 |
| | | | | | 30 | 2" B 28/30 |
| | | | | | 30 | 2" C 24/30 |
| | | | | PREHEAT 6TH FLOOR | 36 | 3" A 32/30 |
| | | | | | 36 | 3" B 32/30 |
| | | | | HEAT CORE | 36 | 3" C 36/30 |
| | | | | | 37 | 3" A 38/35 |
| | | | | | 39 | 3" B 40/35 |
| | | | | HEAT T10 6TH FLOOR | 41 | 3" C 42/30 |
| | | | | | 41 | 3" C 42/30 |

TOTAL CONNECTED AMPS: 802/28
 RATE VOLTAGE: 277/480 3 PHASE, 4 WIRE
 RATED AMPS OF: 400 BUSING 400 MLO
 FULLY RATED BREAKER ISC 42 K AIG SWML
 LOCATION: 6TH FL. MECH. ROOM
 CONNECTED AMPS PER PHASE = 223

REUSE EXISTING 30 AMPS, 3 POLE BREAKER

NAV SAFETY DISCONNECTS BY DIVISION 15

ALTERNATE #1
 ELECTRICAL PANEL SCHEDULES

CONSULTING ENGINEERING GROUP INC.
 8840 NORTH FLORIDA AVE
 TAMPA, FL 33624
 P. 813.989-9194
 FAX. 813.989-9199

CONSULTING ENGINEERS - ELECTRICAL

ELECTRICAL PANEL SCHEDULES