



# CITY OF TAMPA

Pam Iorio, Mayor

CONTRACT ADMINISTRATION DEPARTMENT

David L. Vaughn, AIA, Director

**ADDENDUM NO. 1**  
**DATE: JULY 30, 2007**

Contract: 7-C-20; Replace Large Pump Station Flow Meters - San Carlos Pump Station Flow Meters & Emergency Bypass

Bidders on the above referenced project are hereby notified that the following addendum is made to the Contract Documents. BIDS TO BE SUBMITTED SHALL CONFORM TO THIS NOTICE.

**Item 1 - Workmanship and Materials**

Change, in Section 35 - Magnetic Flowmeters, on page W35-1, in subsection 2.0 Flow Meter, in 2.2, in the sixth line, "neoprene" To Read: Polyurethane

Delete, in Section 35 - Magnetic Flowmeters, on page 35-3, Section 4.0, In Its Entirety

**Item 2 - Plans**

Replace, Sheets 4 of 12 and 5 of 12 With the Attached Sheets 4 of 12 and 5 of 12

This addendum shall be included in and attached to the inside cover of the Contract Documents by and upon which bids are submitted.

All other provisions of the Contract Documents and Specifications not in conflict with this Addendum shall remain in full force and effect.

Questions may be directed to Jim Greiner, P.E.; Telephone (813) 274-8598, fax (813) 274-8080, or e-mail [Jim.Greiner@tampagov.net](mailto:Jim.Greiner@tampagov.net).

Jim Greiner, P.E., Contract Manager  
Contract Administration Department




No. 02208  
 CITY OF TAMPA  
 PUBLIC WORKS DEPARTMENT  
 WASTEWATER DIVISION  
 ANTHONY J. ...  
 DESIGN DIVISION  
 WASTEWATER DEPARTMENT

No.	DATE	REVISIONS
3		
2		
1	07/25/07	Added 24" plug valve.

DES. JF	DRN. RS	DATE:

CITY OF TAMPA  
 WASTEWATER DEPARTMENT  
 REPLACE LARGE PUMP STATION FLOW METERS -  
 SAN CARLOS PUMP STATION FLOW METERS  
 & EMERGENCY BYPASS (CONTRACT 7-C-20)  
 • PROPOSED EMERGENCY BYPASS PIPE-PROFILE VIEW •

W.O. 5357	SHEET
	5
	OF 12

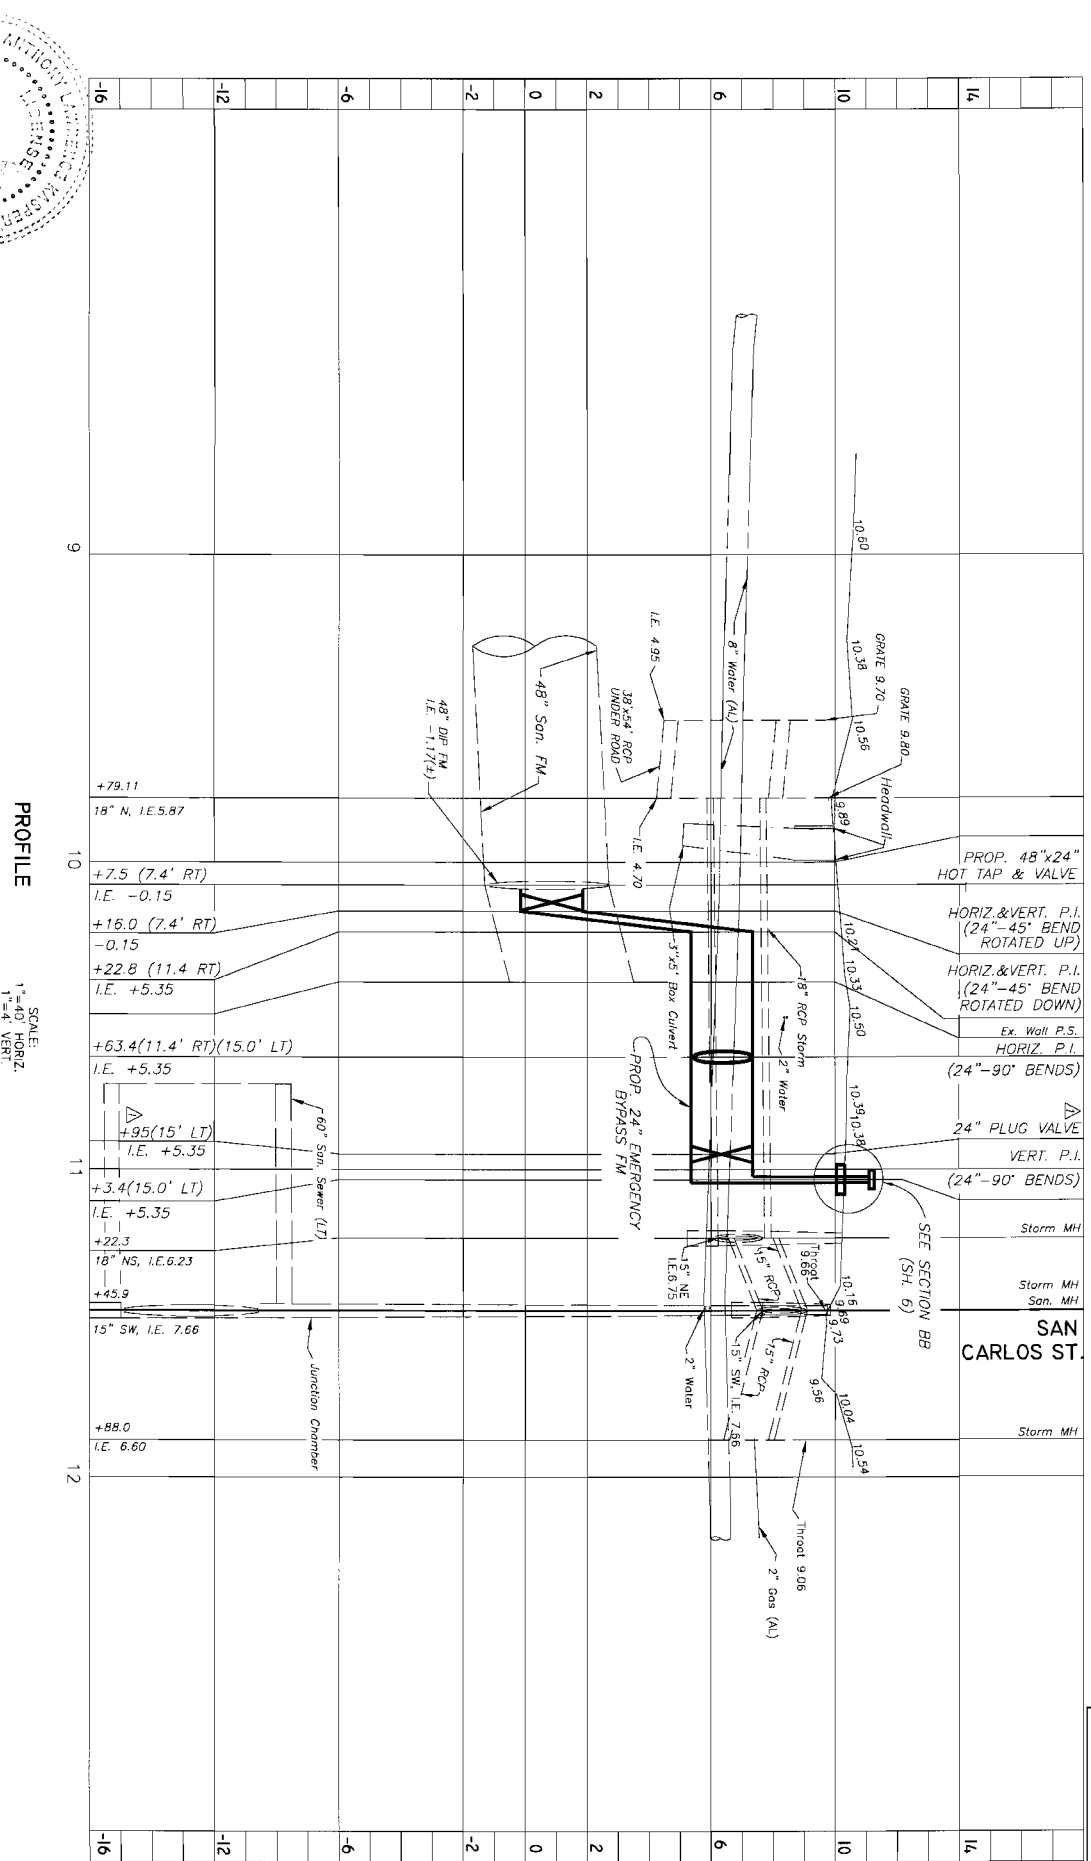

3060-005