

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

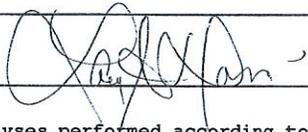
POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 15, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 023 (23 of 49)
LABORATORY NUMBER: 065572
SAMPLE/LOCATION: Interior wall concrete coating (gray-beige),
Homogeneous Area #11.

SAMPLE DESCRIPTION: Gray-beige cementitious aggregate.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999


POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 15, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 024 (24 of 49)
LABORATORY NUMBER: 065573
SAMPLE/LOCATION: Brake lining (small brake on southside),
Homogeneous Area #12.

SAMPLE DESCRIPTION: Black brake material with white fiber bundles.

Asbestos Minerals	Estimated Percentage
Chrysotile	50
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
<hr/>	
Total Asbestos Content =	50
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	20
Other	0
Nonfibrous	30
<hr/>	
Total	100

Comments: The black brake material contains 50% chrysotile asbestos.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS


DATE: November 17, 2006
 CLIENT: City of Tampa
 PROJECT: Laurel Street Bridge
 DATE COLLECTED: November 15, 2006
 COLLECTED BY: Mike Witt
 ANALYST: Lara A. Davis
 PROJECT NUMBER: AD-25553
 SAMPLE ID.: 025 (25 of 49)
 LABORATORY NUMBER: 065574
 SAMPLE/LOCATION: Brake lining (small brake on northside),
 Homogeneous Area #12.

SAMPLE DESCRIPTION: Black brake material with white fiber bundles.

Asbestos Minerals	Estimated Percentage
Chrysotile	50
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content =	
	50
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	20
Other	0
Nonfibrous	<u>30</u>
Total	
	100

Comments: The black brake material contains 50% chrysotile asbestos.

Respectfully submitted, _____



The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999


POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 15, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 026 (26 of 49)
LABORATORY NUMBER: 065575
SAMPLE/LOCATION: Brake lining (large brake on southside),
Homogeneous Area #13.

SAMPLE DESCRIPTION: Black brake material with white fiber bundles.

Asbestos Minerals	Estimated Percentage
Chrysotile	50
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content =	50
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	20
Other	0
Nonfibrous	<u>30</u>
Total	100

Comments: The black brake material contains 50% chrysotile asbestos.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 15, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 027 (27 of 49)
LABORATORY NUMBER: 065576
SAMPLE/LOCATION: Brake lining (large brake on northside),
Homogeneous Area #13.

SAMPLE DESCRIPTION: Black brake material with white fiber bundles.

Asbestos Minerals	Estimated Percentage
Chrysotile	50
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content =	50
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	20
Other	0
Nonfibrous	<u>30</u>
Total	100

Comments: The black brake material contains 50% chrysotile asbestos.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999


POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 15, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 028 (28 of 49)
LABORATORY NUMBER: 065577
SAMPLE/LOCATION: Window glazing (off-white), from southside,
Homogeneous Area #14.

SAMPLE DESCRIPTION: Off-white, soft, chalky caulk.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

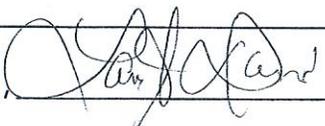
POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 15, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 029 (29 of 49)
LABORATORY NUMBER: 065578
SAMPLE/LOCATION: Window glazing (off-white), from southside,
Homogeneous Area #14.

SAMPLE DESCRIPTION: Off-white, soft, chalky caulk.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

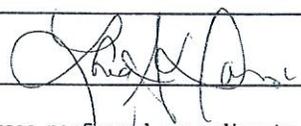
11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 15, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 030 (30 of 49)
LABORATORY NUMBER: 065579
SAMPLE/LOCATION: Bottom of bridge deck (silver/beige),
Homogeneous Area #15.
SAMPLE DESCRIPTION: Silver paint over beige-gray cementitious
aggregate.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	2
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>98</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's,
Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples,
EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples,
thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement
to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval,
or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information
contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.


11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 15, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 031 (31 of 49)
LABORATORY NUMBER: 065580
SAMPLE/LOCATION: Bottom of bridge deck (silver/beige),
Homogeneous Area #15.
SAMPLE DESCRIPTION: Silver paint over beige-gray cementitious
aggregate.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	2
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>98</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's,
Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples,
EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples,
thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement
to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval,
or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information
contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999


POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 15, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 032 (32 of 49)
LABORATORY NUMBER: 065581
SAMPLE/LOCATION: Material between bridge deck and filler (beige),
Homogeneous Area #16.

SAMPLE DESCRIPTION: Beige-gray cementitious aggregate.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's,
Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples,
EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples,
thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement
to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval,
or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information
contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999


POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 15, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 033 (33 of 49)
LABORATORY NUMBER: 065582
SAMPLE/LOCATION: Material between bridge deck and filler (beige),
Homogeneous Area #16.

SAMPLE DESCRIPTION: Beige-gray cementitious aggregate.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

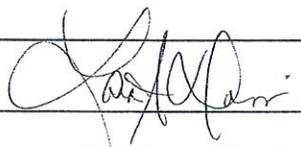
POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 15, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 034 (34 of 49)
LABORATORY NUMBER: 065583
SAMPLE/LOCATION: Material between bridge deck and steel beam (black-gray), Homogeneous Area #17.

SAMPLE DESCRIPTION: Black-gray, soft caulk.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	10
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	90
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonston, FL 33534 (813) 671-3999


POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
 CLIENT: City of Tampa
 PROJECT: Laurel Street Bridge
 DATE COLLECTED: November 15, 2006
 COLLECTED BY: Mike Witt
 ANALYST: Lara A. Davis
 PROJECT NUMBER: AD-25553
 SAMPLE ID.: 035 (35 of 49)
 LABORATORY NUMBER: 065584
 SAMPLE/LOCATION: Material between bridge deck and steel beam (black-gray), Homogeneous Area #17.

SAMPLE DESCRIPTION: Silver paint over rust coating over beige-gray cementitious aggregate.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.


11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 15, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 036 (36 of 49)
LABORATORY NUMBER: 065585
SAMPLE/LOCATION: Gasket between sheet metal layers (silver),
Homogeneous Area #18.
SAMPLE DESCRIPTION: Silver paint over black tar with white fiber
bundles.

Asbestos Minerals	Estimated Percentage
Chrysotile	70
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
<hr/>	
Total Asbestos Content =	70
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	30
<hr/>	
Total	100

Comments: The black tar with white fiber bundles contains 75% chrysotile
asbestos. No asbestos detected in any other layer. Overall the asbestos
content is 70% chrysotile asbestos.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's,
Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples,
EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples,
thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement
to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval,
or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information
contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999


POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 15, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 037 (37 of 49)
LABORATORY NUMBER: 065586
SAMPLE/LOCATION: Gasket between sheet metal layers (silver),
Homogeneous Area #18.

SAMPLE DESCRIPTION: Silver paint over black tar with white fiber bundles.

Asbestos Minerals	Estimated Percentage
Chrysotile	70
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content =	70
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>30</u>
Total	100

Comments: The black tat with white fiber bundles contains 75% chrysotile asbestos. No asbestos detected in any other layer. Overall asbestos content is 70% chrysotile asbestos.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 15, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 038 (38 of 49)
LABORATORY NUMBER: 065587
SAMPLE/LOCATION: Expanded metal filler on road (white),
Homogeneous Area #19.

SAMPLE DESCRIPTION: White cementitious aggregate.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999


POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 17, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 15, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 039 (39 of 49)
LABORATORY NUMBER: 065588
SAMPLE/LOCATION: Expanded metal filler on road (white),
Homogeneous Area #19.

SAMPLE DESCRIPTION: White cementitious aggregate.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.


11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 21, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 17, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 040 (40 of 49)
LABORATORY NUMBER: 065631
SAMPLE/LOCATION: Black gaskets - pad under hydraulic posts,
from East end of span, Homogeneous Area #20.
SAMPLE DESCRIPTION: Semi-hard, black, rubbery material.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

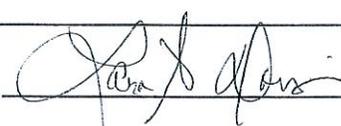
11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 21, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 17, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 041 (41 of 49)
LABORATORY NUMBER: 065632
SAMPLE/LOCATION: Black gaskets - pad under hydraulic posts,
from East end of span, Homogeneous Area #20.
SAMPLE DESCRIPTION: Semi-hard, black, rubbery material.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

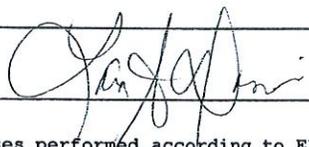
POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 21, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 17, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 042 (42 of 49)
LABORATORY NUMBER: 065633
SAMPLE/LOCATION: Silver paint from North guard rail,
Homogeneous Area #21.

SAMPLE DESCRIPTION: Silver and red paint chips with rust debris.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999


POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 21, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 17, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 043 (43 of 49)
LABORATORY NUMBER: 065634
SAMPLE/LOCATION: Silver paint from North guard rail,
Homogeneous Area #21.

SAMPLE DESCRIPTION: Silver and red paint chips with rust debris.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonston, FL 33534 (813) 671-3999


POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 21, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 17, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 044 (44 of 49)
LABORATORY NUMBER: 065635
SAMPLE/LOCATION: Flat roof field material (silver/black), from
North end, Homogeneous Area #22.

SAMPLE DESCRIPTION: Silver paint over two layers of black tarpaper.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	12
Fibrous Glass	0
Synthetic Fibers	20
Other (Fibrous Talc)	3
Nonfibrous	65
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999


POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 21, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 17, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 045 (45 of 49)
LABORATORY NUMBER: 065636
SAMPLE/LOCATION: Flat roof field material (silver/black), from South end, Homogeneous Area #22.

SAMPLE DESCRIPTION: Silver paint over two layers of black tarpaper.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	12
Fibrous Glass	0
Synthetic Fibers	20
Other (Fibrous Talc)	3
Nonfibrous	<u>65</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 21, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 20, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 046 (46 of 49)
LABORATORY NUMBER: 065637
SAMPLE/LOCATION: Window frame caulk (silver/beige), from
South Mechanical Room, Homogeneous Area #23.


SAMPLE DESCRIPTION: Silver paint over beige cementitious aggregate.

Asbestos Minerals

Estimated Percentage

Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	2
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	98
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999


POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 21, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 20, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 047 (47 of 49)
LABORATORY NUMBER: 065638
SAMPLE/LOCATION: Window frame caulk (silver/beige), from
North Mechanical Room, Homogeneous Area #23.

SAMPLE DESCRIPTION: Silver paint over beige cementitious aggregate.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	2
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	98
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.


11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 21, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 20, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 048 (48 of 49)
LABORATORY NUMBER: 065639
SAMPLE/LOCATION: Metal covers caulk (gray), from South Mechanical Room, Homogeneous Area #24.
SAMPLE DESCRIPTION: Semi-soft, gray, rubbery caulk.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.


11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 21, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 20, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 049 (49 of 49)
LABORATORY NUMBER: 065640
SAMPLE/LOCATION: Metal covers caulk (gray), from North Mechanical Room, Homogeneous Area #24.
SAMPLE DESCRIPTION: Semi-soft, gray, rubbery caulk.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

SAMPLE ANALYSIS REQUEST FORM AND CUSTODY RECORD

AD#: 25553

CLIENT NAME: City of Tampa

ADDRESS: _____

TELEPHONE: _____ FAX: _____

CONTACT PERSON: _____

PROJECT NAME: Laurel Street Bridge - Tampa

SAMPLE(S) COLLECTED BY: M. Witt

DATE SAMPLES COLLECTED: 11/15/06

Type of Analysis:

Of Samples

- | | | |
|-------------------------------------|---|-----------|
| <input checked="" type="checkbox"/> | PLM - Building Material for Asbestos Content | <u>39</u> |
| <input type="checkbox"/> | PCM - Air Samples NIOSH 7400 Method ORM | _____ |
| <input type="checkbox"/> | TEM - Asbestos in Air | _____ |
| <input type="checkbox"/> | H2O - TDS, Sulfate, Chloride | _____ |
| <input type="checkbox"/> | Lead - Atomic Absorption, Lead in Paint/Water/Air | _____ |
| <input type="checkbox"/> | IAQ - Bioaerosols | _____ |
| <input type="checkbox"/> | IAQ - Swabs | _____ |
| <input type="checkbox"/> | Air-O-Cell Samples | _____ |
| <input type="checkbox"/> | Other, Please List: _____ | _____ |

Turn Around Time Requested:

- Rush-ASAP 24 Hour 48 Hour Normal

Released By: <u>F. Mike Witt</u>	Date/Time: <u>11/15/06</u>	Received By: <u>[Signature]</u>	Date/Time: <u>11-15-06</u>
Print Name: <u>F. Mike Witt</u>		Print Name: _____	<u>3:40 PM</u>
Released By: _____	Date/Time: _____	Received By: _____	Date/Time: _____
Print Name: _____		Print Name: _____	

COMMENTS/NOTES: _____

APOLLO ENVIRONMENTAL, INC.

11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999


POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 29, 2006
 CLIENT: City of Tampa
 PROJECT: Laurel Street Bridge
 DATE COLLECTED: November 29, 2006
 COLLECTED BY: Mike Witt
 ANALYST: Lara A. Davis
 PROJECT NUMBER: AD-25553
 SAMPLE ID.: 050 (50 of 51)
 LABORATORY NUMBER: 065753
 SAMPLE/LOCATION: Electric light pole/electric access box lids,
 hard putty gasket (beige/rust/gray), from east
 end of bridge - sidewalk, Homogeneous Area #25.
 SAMPLE DESCRIPTION: Beige and rust colored particulate with fine
 gravel covering a light gray mastic layer.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, _____



The above test report relates only to the items tested. Analyses performed according to EPA's, Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples, EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples, thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

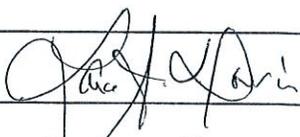
11553 U.S. Hwy 41 South
Gibsonton, FL 33534 (813) 671-3999

POLARIZED LIGHT MICROSCOPY / BULK SAMPLE ANALYSIS

DATE: November 29, 2006
CLIENT: City of Tampa
PROJECT: Laurel Street Bridge
DATE COLLECTED: November 29, 2006
COLLECTED BY: Mike Witt
ANALYST: Lara A. Davis
PROJECT NUMBER: AD-25553
SAMPLE ID.: 051 (51 of 51)
LABORATORY NUMBER: 065754
SAMPLE/LOCATION: Electric light pole/electric access box lids,
hard putty gasket (beige/rust/gray), from east
end of bridge - sidewalk, Homogeneous Area #25.
SAMPLE DESCRIPTION: Beige and rust colored particulate with fine
gravel covering a light gray mastic layer.

Asbestos Minerals	Estimated Percentage
Chrysotile	-
Amosite	-
Crocidolite	-
Anthophyllite	-
Tremolite/Actinolite	-
Total Asbestos Content = None Detected	
Cellulose	0
Fibrous Glass	0
Synthetic Fibers	0
Other	0
Nonfibrous	<u>100</u>
Total	100

Comments: No asbestos detected in any layer.

Respectfully submitted, 

The above test report relates only to the items tested. Analyses performed according to EPA's,
Interim Method for the Determination of Asbestiform Minerals in Bulk Insulation Samples,
EPA-600/R-93/116

It has been established that PLM may miss small percentages of asbestos in bulk samples,
thus negative PLM results cannot be guaranteed.

Client accepts visual estimate of asbestos content and waives EPA requirement
to point count samples with asbestos content between trace and 10% asbestos.

NVLAP ID #1871 (This report cannot be used to claim product certification, approval,
or endorsement by NVLAP, NIST, or any agency of the federal government)

All reports are the confidential property of our clients and the information
contained herein may not be published or reproduced pending our written permission.
(Revision 4, September 2005)

APOLLO ENVIRONMENTAL, INC.

SAMPLE ANALYSIS REQUEST FORM AND CUSTODY RECORD

AD#: 25553

CLIENT NAME: City of Tampa

ADDRESS: _____

TELEPHONE: _____ FAX: _____

CONTACT PERSON: _____

PROJECT NAME: Laurel Street Bridge

SAMPLE(S) COLLECTED BY: AP/16 F. Witt

DATE SAMPLES COLLECTED: Monday 11-20-06 and Friday 11-17-06

Type of Analysis:	# Of Samples
<input checked="" type="checkbox"/> PLM - Building Material for Asbestos Content	<u>10</u>
<input type="checkbox"/> PCM - Air Samples NIOSH 7400 Method ORM	_____
<input type="checkbox"/> TEM - Asbestos in Air	_____
<input type="checkbox"/> H2O - TDS, Sulfate, Chloride	_____
<input type="checkbox"/> Lead - Atomic Absorption, Lead in Paint/Water/Air	_____
<input type="checkbox"/> IAQ - Bioaerosols	_____
<input type="checkbox"/> IAQ - Swabs	_____
<input type="checkbox"/> Air-O-Cell Samples	_____
<input type="checkbox"/> Other, Please List: _____	_____

Turn Around Time Requested:

Rush-ASAP 24 Hour 48 Hour Normal

Released By: <u>F. Witt</u>	Date/Time: <u>11-20-06</u>	Received By: <u>[Signature]</u>	Date/Time: <u>4:12 PM</u>
Print Name: <u>F. Witt</u>	<u>2 PM</u>	Print Name: _____	<u>11-20-06</u>
Released By: _____	Date/Time: _____	Received By: _____	Date/Time: _____
Print Name: _____	_____	Print Name: _____	_____

COMMENTS/NOTES: _____

APOLLO ENVIRONMENTAL, INC.

SAMPLE ANALYSIS REQUEST FORM AND CUSTODY RECORD

AD#: 25553

CLIENT NAME: City of Tampa

ADDRESS: _____

TELEPHONE: _____ FAX: _____

CONTACT PERSON: _____

PROJECT NAME: Laurel Street Bridge

SAMPLE(S) COLLECTED BY: APOLLO Fmwith

DATE SAMPLES COLLECTED: Wednesday 11-29-2006

Type of Analysis:

Of Samples

- PLM - Building Material for Asbestos Content 2
- PCM - Air Samples NIOSH 7400 Method ORM _____
- TEM - Asbestos in Air _____
- H2O - TDS, Sulfate, Chloride _____
- Lead - Atomic Absorption, Lead in Paint/Water/Air _____
- IAQ - Bioaerosols _____
- IAQ - Swabs _____
- Air-O-Cell Samples _____
- Other, Please List: _____

Turn Around Time Requested:

- Rush-ASAP 24 Hour 48 Hour Normal

Released By: <u>F Mike With</u>	Date/Time: <u>11-29-06 2:10 PM</u>	Received By: <u>[Signature]</u>	Date/Time: <u>11-29-06 2:17 PM</u>
Print Name: <u>F Mike With</u>		Print Name: _____	
Released By: _____	Date/Time: _____	Received By: _____	Date/Time: _____
Print Name: _____		Print Name: _____	

COMMENTS/NOTES: _____

Appendix 3
Survey Certifications

ABiH[®]

american board of industrial hygiene[®]

organized to improve the practice of industrial hygiene
proclaims that

Patricia Craig Mitchell

having met all requirements through
education, experience and examination,
is hereby certified in the

COMPREHENSIVE PRACTICE
of
INDUSTRIAL HYGIENE

and has the right to use the designations

CERTIFIED INDUSTRIAL HYGIENIST

CIH

Certificate Number: 6441 CP

Awarded: July 22, 1994

Expiration Date: June 1, 2011

Lawrence D. Keane
Chairman ABIH

Lynn C. O'Connell
Executive Director ABIH

AC# 2915801

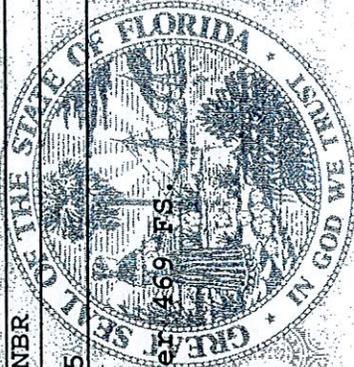
STATE OF FLORIDA

DEPARTMENT OF BUSINESS AND PROFESSIONAL REGULATION
ASBESTOS LICENSING UNIT
SEQ# L06102401986

DATE	BATCH NUMBER	LICENSE NBR
10/24/2006	068085109	AX0000005

The ASBESTOS CONSULTANT
Named below IS LICENSED
Under the provisions of Chapter 469 FS.
Expiration date: NOV 30, 2008

MITCHELL, PATRICIA CRAIG
11553 US HIGHWAY 41 S
GIBSONTON FL 33534



JEB BUSH
GOVERNOR

SIMONE MARSTILLER
SECRETARY

DISPLAY AS REQUIRED BY LAW

AC# 2170002

STATE OF FLORIDA

DEPARTMENT OF BUSINESS AND PROFESSIONAL REGULATION SEQ#L05083105023
ASBESTOS LICENSING UNIT

DATE	BATCH NUMBER	LICENSE NBR
08/31/2005	050194869	ZA0000001

The ASBESTOS BUSINESS ORGANIZATION
Named below IS LICENSED
Under the provisions of Chapter 469, FS.
Expiration date: NOV 30, 2007



APOLLO ENVIRONMENTAL INC
PATRICIA MITCHELL
11553 US HIGHWAY 41, SOUTH
GIBSONTON FL 33534

JEB BUSH
GOVERNOR

SIMONE MARSTILLER
SECRETARY

DISPLAY AS REQUIRED BY LAW

AC 1927886

STATE OF FLORIDA

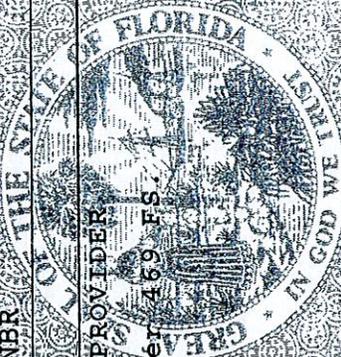
DEPARTMENT OF BUSINESS AND PROFESSIONAL REGULATION
ASBESTOS LICENSING UNIT
SEC# 105031805210

DATE BATCH NUMBER LICENSE NBR

03/18/2005 040777511 PVD38

The ASBESTOS TRAINING COURSE PROVIDER
Named below IS APPROVED
Under the provisions of Chapter 469 FS.
Expiration date: MAY 31, 2007

APOLLO ENVIRONMENTAL INC
P.O. BOX 239
GIBSONTON FL 33534

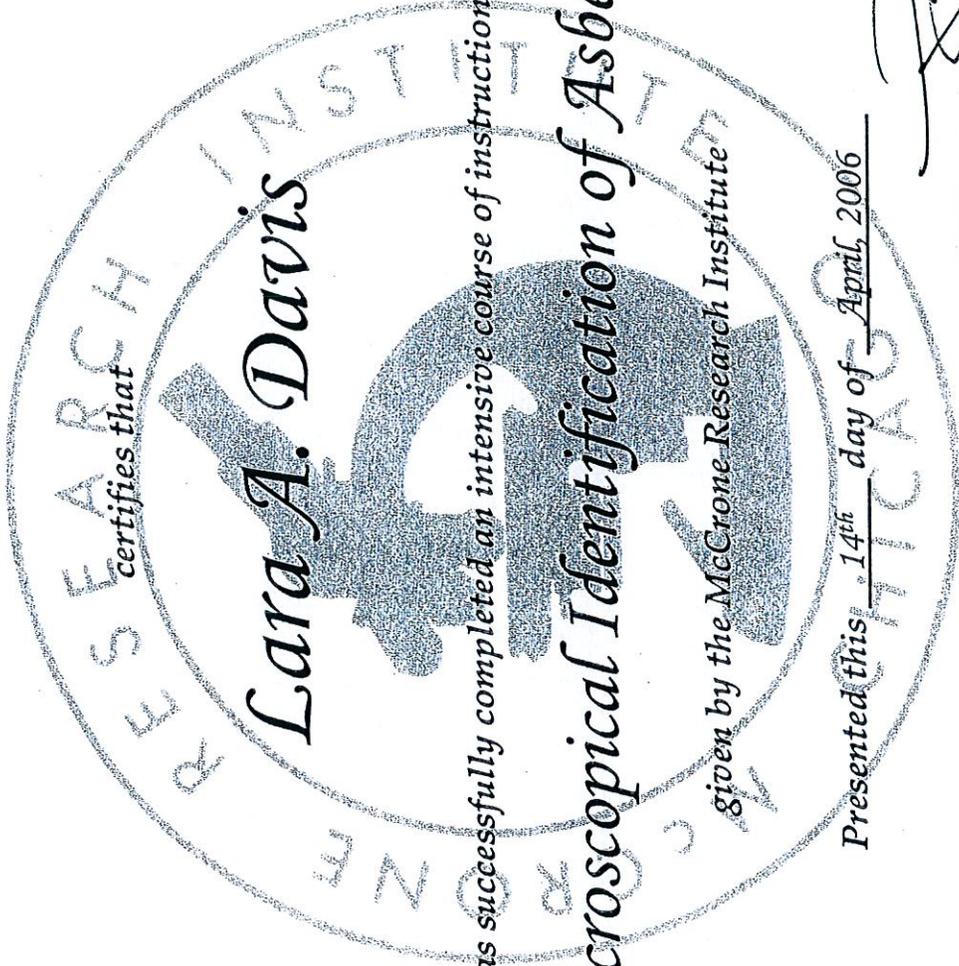


JEB BUSH
GOVERNOR

DIANE CARR
SECRETARY

DISPLAY AS REQUIRED BY LAW

McCRONE RESEARCH INSTITUTE



Lara A. Davis

has successfully completed an intensive course of instruction in

Microscopical Identification of Asbestos

given by the McCrone Research Institute

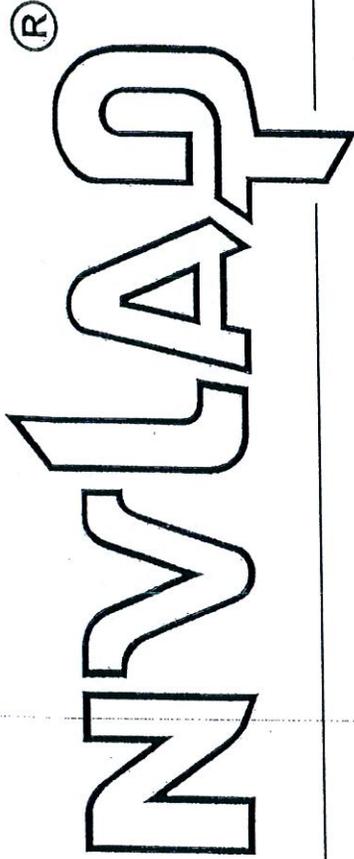
Presented this 14th day of April, 2006

[Signature]

Larry J. Sangalli

Course Date: April 10-14, 2006
3.5 CEU's

United States Department of Commerce
National Institute of Standards and Technology



Certificate of Accreditation to ISO/IEC 17025:1999

NVLAP LAB CODE: 101871-0

Apollo Environmental, Inc.
Gibsonton, FL

is recognized by the National Voluntary Laboratory Accreditation Program for conformance with criteria set forth in
NIST Handbook 150:2001 and all requirements of ISO/IEC 17025:1999.

Accreditation is granted for specific services, listed on the Scope of Accreditation, for:

BULK ASBESTOS FIBER ANALYSIS

2006-10-01 through 2007-09-30

Effective dates



Jolly S. Bruce
For the National Institute of Standards and Technology

APOLLO ENVIRONMENTAL, INC.

Hereby certifies that

Patricia Craig

License # - LAC #AXX0000005

SS # 151-50-7510

Certification # IN080506-03R

has successfully completed the requisite training for asbestos accreditation under TSCA Title II and Chapter 469, Florida Statutes, and Rule 61 E1, Florida Administrative Code

Survey and Mechanical Systems Refresher

Course #0004685 - Length of Course: 4 Hours

August 5, 2006

Date Course Offered

Expires: August 5, 2007



Alex A. Cerekwicki - Course Instructor
CIH # CP7723

Provider: Apollo Environmental, Inc., P. O. Box 239 Gibsonton, Florida 33534 (813) 671-3999

Provider # 001210

APOLLO ENVIRONMENTAL, INC.

Hereby certifies that

Michael L. Williamson

License # - Not Applicable

SS # 265-82-5575

Certification # IN080506-05R

has successfully completed the requisite training for asbestos accreditation under TSCA Title II and Chapter 469, Florida Statutes, and Rule 61 E1, Florida Administrative Code

Survey and Mechanical Systems Refresher

Course #0004685 - Length of Course: 4 Hours

August 5, 2006

Date Course Offered
Expires: August 5, 2007



Patricia Craig - Course Instructor
LAC #AX 0000005

Provider: Apollo Environmental, Inc., P. O. Box 239 Gibsonton, Florida 33534 (813) 671-3999
Provider # 001210

APOLLO ENVIRONMENTAL, INC.

Hereby certifies that

F. Michael Witt

License # - Not Applicable

SS #261-23-0800

Certification # IN080506-06R

has successfully completed the requisite training for asbestos accreditation under TSCA Title II and Chapter 469, Florida Statutes, and Rule 61 E1, Florida Administrative Code

Survey and Mechanical Systems Refresher

Course #0004685 - Length of Course: 4 Hours

August 5, 2006

Patricia Craig

Date Course Offered
Expires: August 5, 2007

Patricia Craig - Course Instructor
LAC #AX 0000005

Provider: Apollo Environmental, Inc., P. O. Box 239 Gibsonton, Florida 33534 (813) 671-3999
Provider # 001210