


Seneca Pump Station Site Improvements

FY 2017, District 7


Estimated cost: \$100K

JUSTIFICATION:

Seneca Pump Station was determined to be obsolete and unnecessary due to reconfigurations of the drainage system serviced by Curiosity Creek Pump Station. Under Phase 1, the pump station building and mechanical equipment were removed. The runoff accumulated in the Seneca pond will flow north to 109th Ave.

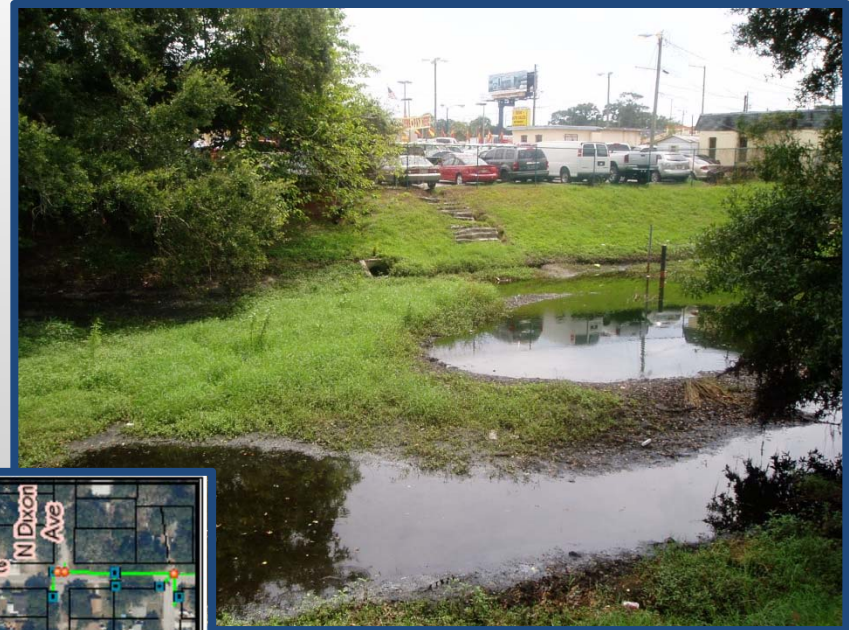

PROPOSED PROJECT MAP

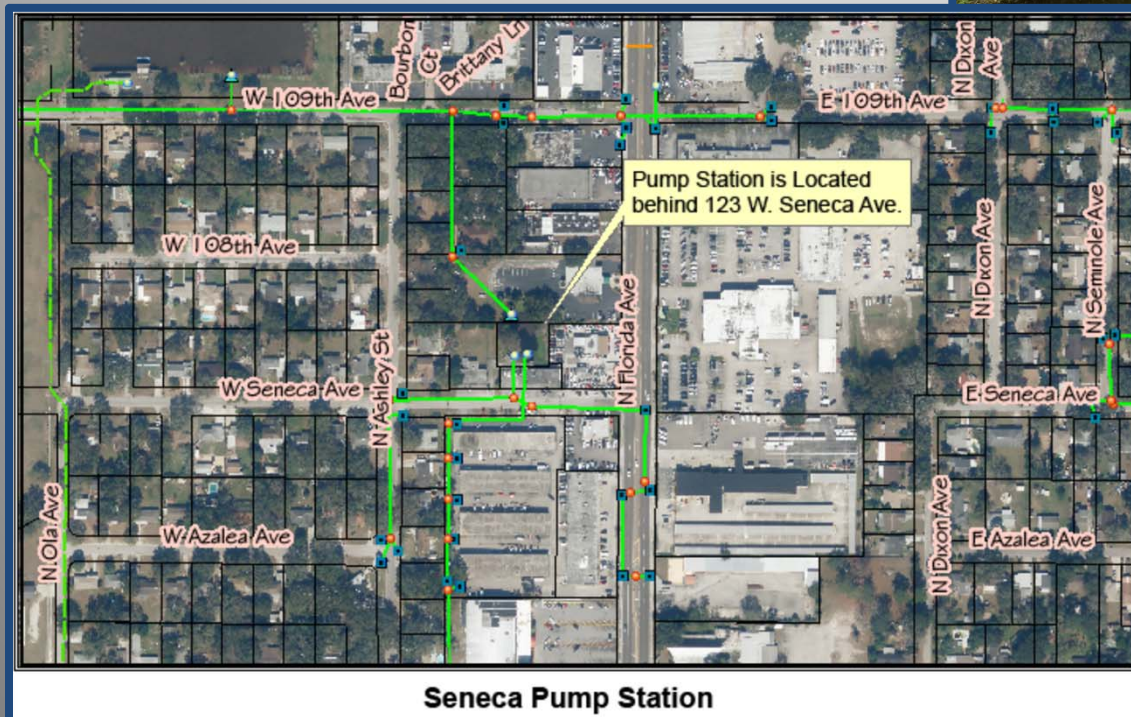

PROJECT DESCRIPTION:

This project will include constructing a new control structure on the existing outflow pipe, stabilizing the pond banks, and controlling erosion caused by runoff flow from adjacent properties.